GENERAL NOTES:

1. SEE CONCRETE SIDEWALK RAMPS GUIDE SHEETS FOR PEDESTRIAN RAMP TYPES.
2. ALL CURBING SHALL BE INSTALLED AS EITHER PRECAST OR CAST IN PLACE AS DIRECTED.

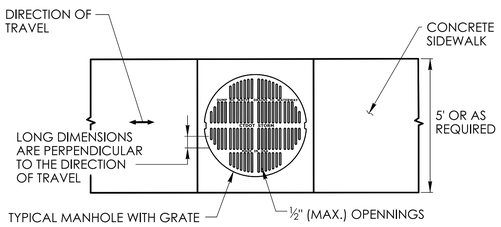

PEDESTRIAN ACCESS ROUTE OVER A MANHOLE WITH GRATE

1. HORIZONTAL OPENINGS IN GRATES AND JOINTS MUST NOT BE MORE THAN ½ INCH
2. ELONGATED OPENINGS IN GRATES MUST BE PLACED SO THAT THE LONG DIMENSION IS PERPENDICULAR TO THE DIRECTION OF TRAVEL

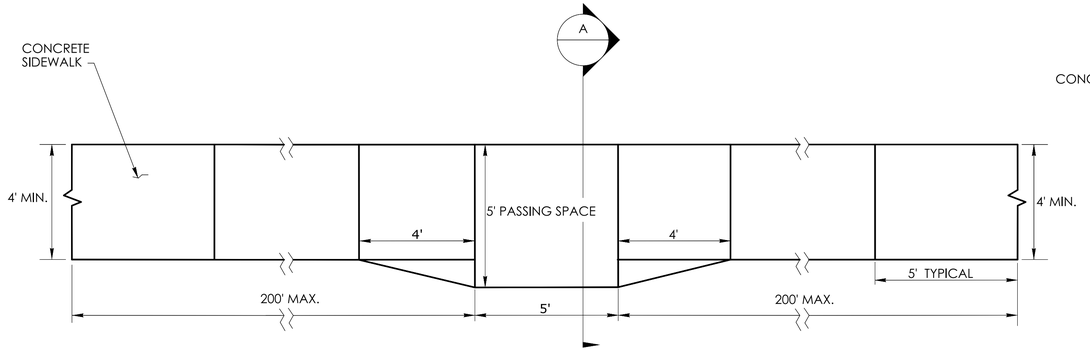

5' PASSING SPACE FOR 4' WIDE SIDEWALK PLAN

PASSING SPACES SHALL BE PROVIDED AT INTERVALS OF 200' MAXIMUM FOR SIDEWALKS LESS THAN 5' IN WIDTH

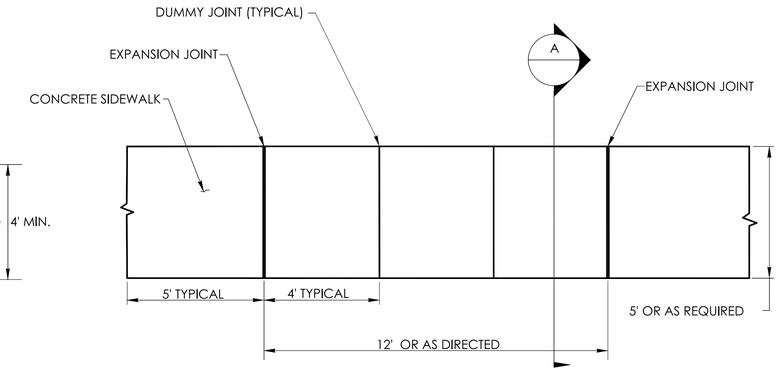

5' WIDE SIDEWALK PLAN

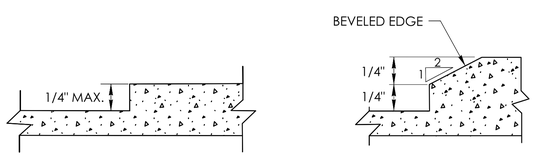

VERTICAL SURFACE DISCONTINUITIES

VERTICAL SURFACE DISCONTINUITIES MUST BE BEVELED TO A HEIGHT NOT GREATER THAN ¼ INCH. THE BEVEL MUST BE THE ENTIRE WIDTH OF THE DISCONTINUITY

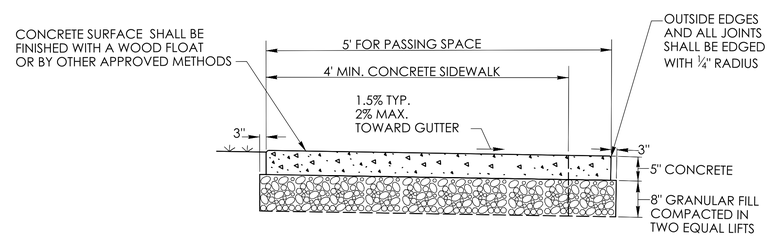

5' PASSING SPACE FOR 4' WIDE SIDEWALK

SECTION A

	NOT TO SCALE	SIGNATURE BLOCK: OFFICE OF ENGINEERING 2800 BERLIN TURNPIKE NEWINGTON, CT 06111	SUBMITTED BY: Digitally signed by Leo Fontaine, P.E. Date: 2024.12.19 15:11:56-05'00'	APPROVED BY: Digitally signed by Michael N. Calabrese, P.E. Date: 2025.01.29 12:47:10-05'00'	CTDOT CONNECTICUT DEPARTMENT OF TRANSPORTATION	CTDOT STANDARD SHEET	STANDARD SHEET TITLE: CONCRETE SIDEWALKS	STANDARD SHEET NO.: HW-921_01

PLOTTED DATE: 10/23/2024