

**TOWN OF PLYMOUTH
PLYMOUTH MUNICIPAL AIRPORT**

RECONSTRUCT RUNWAY 6-24, RECONSTRUCT TAXIWAY H, J, K AND L

AIP No. 3-25-0042-###-2026

ADDENDUM No. 1

Date: April 16, 2026

The following is provided to clarify, add or delete information in the Contract Documents, Specifications and Plans for the above project. This information is required for bidding and construction, and the Bidder's acknowledgement of receipt of this Addendum is required on page B-1 of the BID PROPOSAL.

As a point of clarification, it should be understood that the Contract Documents govern all aspects of the project. Informal discussions held during the Pre-Bid Conference or over the telephone are informational only. All official changes to the Contract Documents are made only by addenda. The following changes and additional information are hereby made a part of the Contract Documents.

CLARIFICATIONS

SPECIFICATIONS

1. Replace Bid Proposal Section:

Remove and replace the entire Bid Proposal Section with the new Bid Proposal attachments.

2. Bid Forms:

Remove and replace the existing bid forms with the attached bid forms. The bid form has been modified to include a pay item for L-125-5.7 Install New In-Pavement LED Runway Edge Light L-850.

3. L-108 Underground Power Cables for Airports:

The L-108 Underground Power Cables for Airports was omitted from the bid set. Insert the attached L-108 specification into the construction specifications.

4. L-125, Installation of Airport Lighting Systems:

Remove and replace the existing L-125 page 4 specification with the attached page specification. The specification has been modified to include a pay item L-125-5.7 Install New In-Pavement LED Runway Edge Light L-850.

5. P-401 Asphalt Mix Pavement:

Remove and replace the existing P-401-page 10 spec with the attached page 10 specification. The specification has been modified to include saw-cut grooving.

DRAWINGS.

The following sheets were modified from the original bid set:

G1.5 Quantities:

Sheet has been revised. See revised sheet.

S2.5 CSPP 5 Phasing Plan:

Sheet has been revised. See revised sheet.

BID PROPOSAL

TABLE OF CONTENTS

TITLE	PAGE
BID PROPOSAL	
Proposal Form	P-1
Schedule of Prices	P-3
Notice to Bidders	P-8
Bid Bond.....	P-9
Certificate of Buy American Compliance for Manufactured Products	P-11
Tax Delinquency and Fellow Convictions	P-13

SCHEDULE OF PRICES
Runway 6-24 Reconstruction
Plymouth Municipal Airport
Plymouth, MA
AIP Project No. 3-25-0042-XXX-2026

Item No.	Brief Description - Unit or Lump Sum Price (in both words and numerals)	Estimated Quantity	Total Bid Price (in numerals)
C-102-5.1	<u>Temporary Seeding & Mulching</u> , per Acre		
	_____ Dollars and	2 AC	
	_____ Cents (\$_____)		\$_____
C-102-5.2	<u>Installation and Removal of Silt Fence</u> , per LF		
	_____ Dollars and	10,500 LF	
	_____ Cents (\$_____)		\$_____
C-102-5.3	<u>Catch Basin Inlet Protection</u> , per EA		
	_____ Dollars and	19 EA	
	_____ Cents (\$_____)		\$_____
C-102-5.4	<u>Erosion Control Matting</u> , per SY		
	_____ Dollars and	500 SY	
	_____ Cents (\$_____)		\$_____
C-102-5.5	<u>Stabilized construction Entrance</u> , per EA		
	_____ Dollars and	2 EA	
	_____ Cents (\$_____)		\$_____
C-102-5.6	<u>Compost Filter Tube</u> , per LF		
	_____ Dollars and	2,650 LF	
	_____ Cents (\$_____)		\$_____
P-150-5.1	<u>Pavement Removal</u> , per SY		
	_____ Dollars and	2,900 SY	
	_____ Cents (\$_____)		\$_____
P-150-5.2	<u>Runway Light Removal</u> , per EA		
	_____ Dollars and	84 EA	
	_____ Cents (\$_____)		\$_____

Item No.	Brief Description - Unit or Lump Sum Price (in both words and numerals)	Estimated Quantity	Total Bid Price (in numerals)
P-150-5.3	<u>Taxiway Light Removal</u> , per EA		
	_____ Dollars and	104 EA	
	_____ Cents (\$_____)		\$_____
P-150-5.4	<u>Guidance Sign Foundation Removal</u> , per EA		
	_____ Dollars and	11 EA	
	_____ Cents (\$_____)		\$_____
P-150-5.5	<u>Pavement Marking Removal</u> , per SY		
	_____ Dollars and	1,300 SY	
	_____ Cents (\$_____)		\$_____
P-152-4.1	<u>Unclassified Excavation</u> , per CY		
	_____ Dollars and	10,400 CY	
	_____ Cents (\$_____)		\$_____
P-207-5.1	<u>In Place For Recycled Asphalt Aggregate Base Course</u> , per SY		
	_____ Dollars and	46,800 SY	
	_____ Cents (\$_____)		\$_____
P-207-5.2	<u>Corrective Aggregate Material (1 1/2" crushed stone)</u> , per CY		
	_____ Dollars and	4,200 CY	
	_____ Cents (\$_____)		\$_____
P-207-5.3	<u>Reuse FDR Aggregate base course</u> , per CY		
	_____ Dollars and	2,000 CY	
	_____ Cents (\$_____)		\$_____
P-401-8.1	<u>Bituminous Pavement – Binder Course (2")</u> , per TON		
	_____ Dollars and	6,550 TON	
	_____ Cents (\$_____)		\$_____

Item No.	Brief Description - Unit or Lump Sum Price (in both words and numerals)	Estimated Quantity	Total Bid Price (in numerals)
P-401-8.2	<u>Bituminous Pavement – Wearing Course</u> , per TON		
	_____ Dollars and	6,550 TON	
	_____ Cents (\$_____)		\$_____
P-603-5.1	<u>Emulsified Asphalt Tack Coat</u> , per GAL		
	_____ Dollars and	2,500 GAL	
	_____ Cents (\$_____)		\$_____
P-605-5.1	<u>Joint Sealant for Pavements</u> , per LF		
	_____ Dollars and	1,500 LF	
	_____ Cents (\$_____)		\$_____
P-620-5.1	<u>White Paint</u> , per SF		
	_____ Dollars and	48,100 SF	
	_____ Cents (\$_____)		\$_____
P-620-5.2	<u>Black Paint</u> , per SF		
	_____ Dollars and	27,500 SF	
	_____ Cents (\$_____)		\$_____
P-620-5.3	<u>Yellow Paint</u> , per SF		
	_____ Dollars and	4,400 SF	
	_____ Cents (\$_____)		\$_____
P-621-5.1	<u>Grooving</u> , per SY		
	_____ Dollars and	27,400 SY	
	_____ Cents (\$_____)		\$_____
T-901-5.1	<u>Seeding</u> , per Acre		
	_____ Dollars and	18 AC	
	_____ Cents (\$_____)		\$_____

Item No.	Brief Description - Unit or Lump Sum Price (in both words and numerals)	Estimated Quantity	Total Bid Price (in numerals)
T-905-5.1	<u>Topsoiling (4")</u> , per CY		
	_____ Dollars and	9,550 CY	
	_____ Cents (\$_____)		\$_____
T-908-5.1	<u>Mulching</u> , per Acre		
	_____ Dollars and	18 AC	
	_____ Cents (\$_____)		\$_____
L-108-5.1	<u>No. 8 AWG, L-824 Cable</u> , per LF		
	_____ Dollars and	20,700 LF	
	_____ Cents (\$_____)		\$_____
L-108-5.2	<u>No. 6 Bare Counterpoise Wire</u> , per LF		
	_____ Dollars and	19,700 LF	
	_____ Cents (\$_____)		\$_____
L-110-5.1	<u>4" 4-Way Concrete Encased Electrical Duct Bank</u> , per LF		
	_____ Dollars and	480 LF	
	_____ Cents (\$_____)		\$_____
L-110-5.2	<u>2" Electrical Conduit</u> , per LF		
	_____ Dollars and	20,300 LF	
	_____ Cents (\$_____)		\$_____
L-110-5.3	<u>Concrete Duct or Splice Marker</u> , per EA		
	_____ Dollars and	12 EA	
	_____ Cents (\$_____)		\$_____
L-110-5.4	<u>2" 1-Way Concrete Encased Electrical Duct Bank</u> , per LF		
	_____ Dollars and	260 LF	
	_____ Cents (\$_____)		\$_____
L-115-5.1	<u>Electric Handhole</u> , per EA		
	_____ Dollars and	12 EA	
	_____ Cents (\$_____)		\$_____

Item No.	Brief Description - Unit or Lump Sum Price (in both words and numerals)	Estimated Quantity	Total Bid Price (in numerals)
L-125-5.1	<u>Install Runway Edge Light L-862,</u> per EA _____ Dollars and _____ Cents (\$_____)	64 EA	\$ _____
L-125-5.2	<u>Relocate Guidance Sign on New Foundation),</u> per EA _____ Dollars and _____ Cents (\$_____)	11 EA	\$ _____
L-125-5.3	<u>Install New Guidance Sign,</u> per EA _____ Dollars and _____ Cents (\$_____)	12 EA	\$ _____
L-125-5.4	<u>L-893 Runway Closure Markers,</u> per EA _____ Dollars and _____ Cents (\$_____)	4 EA	\$ _____
L-125-5.5	<u>Install New Taxiway Edge Light L-861T LED,</u> per EA _____ Dollars and _____ Cents (\$_____)	74 EA	\$ _____
L-125-5.6	<u>Install New Taxiway Edge Light L-861T Quartz,</u> per EA _____ Dollars and _____ Cents (\$_____)	16 EA	\$ _____
L-125-5.7	<u>Install New In-Pavement LED Runway Edge Light L-850,</u> per EA _____ Dollars and _____ Cents (\$_____)	2 EA	\$ _____
GRAND TOTAL			\$ _____

NOTE: In the event of a bidder's mathematical error in tabulating any bid prices, the written unit price shall govern. Selection of the lowest bidder will be based on the calculated total of all items as written in words.

NOTICE TO BIDDERS

It is REQUIRED that all forms within this section be completed by all bidders. The forms within other sections shall be utilized by the apparent low bidder ONLY after being requested to provide by the Sponsor.

In lieu of a Bid Bond form, a certified bankers' check will be accepted as an alternative form of payment. The Bid Bond form may be photocopied as long as it retains the original format. Attachments to the completed bond forms are acceptable.

BID BOND

KNOW ALL PERSONS BY THESE PRESENTS, that we, the undersigned

as Principal, and _____
as Surety, are hereby held and firmly bound unto Town of Plymouth, Massachusetts as OWNER
in the penal sum of _____ for the payment of
which, well and truly to be made, we hereby jointly and severally bind ourselves, successors and
assigns.

Signed, this _____ day of _____, 2026. The Condition of
the above obligation is such that whereas the Principal has submitted to

_____ a certain Bid, attached hereto and hereby
made a part hereof to enter into a contract in writing, for:

Airport Improvements to Include:

**Runway 6-24 Reconstruction
Plymouth Municipal Airport, Plymouth MA
AIP Project No. 3-25-0042-XXX-2026**

NOW, THEREFORE,

- (a) If said Bid shall be rejected, or
- (b) If said Bid shall be accepted and the Principal shall execute and deliver a contract in the Form of Contract attached hereto (properly completed in accordance with said Bid) and shall furnish a Bond for his faithful performance of said contract, and for the payment of all persons performing labor or furnishing materials in connection therewith, and shall in all other respects perform the agreement created by the acceptance of said Bid, then this obligation shall be void, otherwise the same shall remain in force and effect; it being expressly understood and agreed that the liability of the Surety for any and all claims hereunder shall, in no event, exceed the penal amount of this obligation as herein stated.

The Surety, for value received, hereby stipulates and agrees that the obligations of said Surety and its Bond shall be in no way impaired or affected by any extension of the time within which the OWNER may accept such Bid; and said Surety does hereby waive notice of any such extension.

IN WITNESS WHEREOF, the Principal and the Surety have hereunto set their hands and seals, and such of them as are corporations have caused their corporate seals to be hereto affixed and these presents to be signed by their proper officers, the day and year set forth above.

Principal (L.S.)

Surety

By: _____

IMPORTANT - Surety companies must be authorized to transact business in the State of Massachusetts

Certificate of Buy American Compliance for Manufactured Products

As a matter of bid responsiveness, the bidder or offeror must complete, sign, date, and submit this certification statement with their proposal. The bidder or offeror must indicate how they intend to comply with 49 USC § 50101 by selecting one on the following certification statements. These statements are mutually exclusive. Bidder must select one or the other (not both) by inserting a checkmark (✓) or the letter “X”.

- Bidder or offeror hereby certifies that it will comply with 49 USC § 50101 by:
- a) Only installing steel and manufactured products produced in the United States;
 - b) Installing manufactured products for which the Federal Aviation Administration (FAA) has issued a waiver as indicated by inclusion on the current FAA Nationwide Buy American Waivers Issued listing; or
 - c) Installing products listed as an Excepted Article, Material or Supply in Federal Acquisition Regulation Subpart 25.108.

By selecting this certification statement, the bidder or offeror agrees:

1. To provide to the Owner evidence that documents the source and origin of the steel and manufactured product.
 2. To faithfully comply with providing U.S. domestic product.
 3. To furnish U.S. domestic product for any waiver request that the FAA rejects
 4. To refrain from seeking a waiver request after establishment of the contract, unless extenuating circumstances emerge that the FAA determines justified.
- The bidder or offeror hereby certifies it cannot comply with the 100 percent Buy American Preferences of 49 USC § 50101(a) but may qualify for either a Type 3 or Type 4 waiver under 49 USC § 50101(b). By selecting this certification statement, the apparent bidder or offeror with the apparent low bid agrees:
1. To submit to the Owner within 15 calendar days of the bid opening, a formal waiver request and required documentation that supports the type of waiver being requested.
 2. That failure to submit the required documentation within the specified timeframe is cause for a non-responsive determination may result in rejection of the proposal.
 3. To faithfully comply with providing U.S. domestic products at or above the approved U.S. domestic content percentage as approved by the FAA.
 4. To refrain from seeking a waiver request after establishment of the contract, unless extenuating circumstances emerge that the FAA determines justified.

Required Documentation

Type 3 Waiver – The cost of the item components and subcomponents produced in the United States is more than 60 percent of the cost of all components and subcomponents of the “item”. The required documentation for a Type 3 waiver is:

- a) Listing of all product components and subcomponents that are not comprised of 100 percent U.S. domestic content (Excludes products listed on the FAA Nationwide Buy American Waivers Issued listing and products excluded by Federal Acquisition Regulation Subpart 25.108; products of unknown origin must be considered as non-domestic products in their entirety).
- b) Cost of non-domestic components and subcomponents, excluding labor costs associated with final assembly at place of manufacture.
- c) Percentage of non-domestic component and subcomponent cost as compared to total “item” component and subcomponent costs, excluding labor costs associated with final assembly at place of manufacture.

Type 4 Waiver – Total cost of project using U.S. domestic source product exceeds the total project cost using non-domestic product by 25 percent. The required documentation for a Type 4 of waiver is:

- a) Detailed cost information for total project using U.S. domestic product
- b) Detailed cost information for total project using non-domestic product

False Statements: Per 49 USC § 47126, this certification concerns a matter within the jurisdiction of the Federal Aviation Administration and the making of a false, fictitious or fraudulent certification may render the maker subject to prosecution under Title 18, United States Code.

Date

Signature

Company Name

Title

A21 TAX DELINQUENCY AND FELONY CONVICTIONS

A21.1 SOURCE

Section 8113 of the Consolidated Appropriations Act, 2022 (P.L. 117-103) and similar provisions in subsequent appropriations acts.

DOT Order 4200.6 – Appropriations Act Requirements for Procurement and Non-Procurement Regarding Tax Delinquency and Felony Convictions

A21.2 MODEL CERTIFICATION CLAUSE

CERTIFICATION OF OFFEROR/ BIDDER REGARDING TAX DELINQUENCY AND FELONY CONVICTIONS

The applicant must complete the following two certification statements. The applicant must indicate its current status as it relates to tax delinquency and felony conviction by inserting a checkmark (ū) in the space following the applicable response. The applicant agrees that, if awarded a contract resulting from this solicitation, it will incorporate this provision for certification in all lower tier subcontracts.

Certifications

- 1) The applicant represents that it is () is not () a corporation that has any unpaid Federal tax liability that has been assessed, for which all judicial and administrative remedies have been exhausted or have lapsed, and that is not being paid in a timely manner pursuant to an agreement with the authority responsible for collecting the tax liability.
- 2) The applicant represents that it is () is not () a corporation that was convicted of a criminal violation under any Federal law within the preceding 24 months.

Note

If an applicant responds in the affirmative to either of the above representations, the applicant is ineligible to receive an award unless the Sponsor has received notification from the agency suspension and debarment official (SDO) that the SDO has considered suspension or debarment and determined that further action is not required to protect the Government's interests. The applicant therefore must provide information to the owner about its tax liability or conviction to the Owner, who will then notify the FAA Airports District Office, which will then notify the agency's SDO to facilitate completion of the required considerations before award decisions are made.

Term Definitions

Felony conviction: Felony conviction means a conviction within the preceding twenty four (24) months of a felony criminal violation under any Federal law and includes conviction of an offense defined in a section of the U.S. Code that specifically classifies the offense as a felony and conviction of an offense that is classified as a felony under 18 USC § 3559.

Tax Delinquency: A tax delinquency is any unpaid Federal tax liability that has been assessed, for which all judicial and administrative remedies have been exhausted, or have lapsed, and that

is not being paid in a timely manner pursuant to an agreement with the authority responsible for collecting the tax liability.

P- 14

401-4.14 Joints. The formation of all joints shall be made to ensure a continuous bond between the courses and obtain the required density. All joints shall have the same texture as other sections of the course and meet the requirements for smoothness and grade.

The roller shall not pass over the unprotected end of the freshly laid asphalt except when necessary to form a transverse joint. When necessary to form a transverse joint, it shall be made by means of placing a bulkhead or by tapering the course. The tapered edge shall be cut back to its full depth and width on a straight line to expose a vertical face prior to placing the adjacent lane. In both methods, all contact surfaces shall be coated with an asphalt tack coat before placing any fresh asphalt against the joint.

Longitudinal joints which have been left exposed for more than four (4) hours; the surface temperature has cooled to less than 175°F; or are irregular, damaged, uncompacted or otherwise defective shall be cut back with a cutting wheel or pavement saw a maximum of 3 inches to expose a clean, sound, uniform vertical surface for the full depth of the course. All cutback material and any laitance produced from cutting joints shall be removed from the project. Asphalt tack coat in accordance with P-603 shall be applied to the clean, dry joint prior to placing any additional fresh asphalt against the joint. The cost of this work shall be considered incidental to the cost of the asphalt.

401-4.15 Saw-cut grooving. Saw-cut grooves shall be provided as specified in Item P-621.

401-4.16 Diamond grinding. Diamond grinding shall be completed prior to pavement grooving. Diamond grinding shall be accomplished by sawing with saw blades impregnated with industrial diamond abrasive.

Diamond grinding shall be performed with a machine designed specifically for diamond grinding capable of cutting a path at least 3 feet wide. The saw blades shall be 1/8-inch wide with a sufficient number of blades to create grooves between 0.090 and 0.130 inches wide; and peaks and ridges approximately 1/32 inch higher than the bottom of the grinding cut. The actual number of blades will be determined by the Contractor and depend on the hardness of the aggregate. Equipment or grinding procedures that cause ravels, aggregate fractures, spalls or disturbance to the pavement will not be permitted. Contractor shall demonstrate to the RPR that the grinding equipment will produce satisfactory results prior to making corrections to surfaces. Grinding will be tapered in all directions to provide smooth transitions to areas not requiring grinding. The slurry resulting from the grinding operation shall be continuously removed and the pavement left in a clean condition. The Contractor shall apply a surface treatment per P-608 to all areas that have been subject to grinding.

401-4.17 Nighttime paving requirements. The Contractor shall provide adequate lighting during any nighttime construction. A lighting plan shall be submitted by the Contractor and approved by the RPR prior to the start of any nighttime work. All work shall be in accordance with the approved CSPP and lighting plan.

CONTRACTOR QUALITY CONTROL (CQC)

401-5.1 General. The Contractor shall develop a Contractor Quality Control Program (CQCP) in accordance with Item C-100. No partial payment will be made for materials without an approved CQCP.

401-5.2 Contractor quality control (QC) facilities. The Contractor shall provide or contract for testing facilities in accordance with Item C-100. The RPR shall be permitted unrestricted access to inspect the Contractor's QC facilities and witness QC activities. The RPR will advise the Contractor in writing of any noted deficiencies concerning the QC facility, equipment, supplies, or testing personnel and procedures. When the deficiencies are serious enough to be adversely affecting the test results, the incorporation of the materials into the work shall be suspended immediately and will not be permitted to resume until the deficiencies are satisfactorily corrected.

Item L-108 Underground Power Cable for Airports

DESCRIPTION

108-1.1 This item shall consist of furnishing and installing power cables that are direct buried and furnishing and/or installing power cables within conduit or duct banks per these specifications at the locations shown on the plans. It includes excavation and backfill of trench for direct-buried cables only. Also included are the installation of counterpoise wires, ground wires, ground rods and connections, cable splicing, cable marking, cable testing, and all incidentals necessary to place the cable in operating condition as a completed unit to the satisfaction of the RPR. This item shall not include the installation of duct banks or conduit, trenching and backfilling for duct banks or conduit, or furnishing or installation of cable for FAA owned/operated facilities.

EQUIPMENT AND MATERIALS

108-2.1 General.

a. Airport lighting equipment and materials covered by advisory circulars (AC) shall be approved under the Airport Lighting Equipment Certification Program per AC 150/5345-53, current version.

b. All other equipment and materials covered by other referenced specifications shall be subject to acceptance through manufacturer's certification of compliance with the applicable specification, when requested by the RPR.

c. Manufacturer's certifications shall not relieve the Contractor of the responsibility to provide materials per these specifications. Materials supplied and/or installed that do not comply with these specifications shall be removed (when directed by the RPR) and replaced with materials that comply with these specifications at the Contractor's cost.

d. All materials and equipment used to construct this item shall be submitted to the RPR for approval prior to ordering the equipment. Submittals consisting of marked catalog sheets or shop drawings shall be provided. Submittal data shall be presented in a clear, precise and thorough manner. Original catalog sheets are preferred. Photocopies are acceptable provided they are as good a quality as the original. Clearly and boldly mark each copy to identify products or models applicable to this project. Indicate all optional equipment and delete any non-pertinent data. Submittals for components of electrical equipment and systems shall identify the equipment to which they apply on each submittal sheet. Markings shall be made bold and clear with arrows or circles (highlighting is not acceptable). The Contractor is solely responsible for delays in the project that may accrue directly or indirectly from late submissions or resubmissions of submittals.

e. The data submitted shall be sufficient, in the opinion of the RPR, to determine compliance with the plans and specifications. The Contractor's submittals shall be neatly bound in a properly sized 3-ring binder, tabbed by specification section or electronically submitted in pdf format. The RPR reserves the right to reject any and all equipment, materials, or procedures that do not meet the system design and the standards and codes, specified in this document.

f. All equipment and materials furnished and installed under this section shall be guaranteed against defects in materials and workmanship for at least twelve (12) months from the date of final acceptance by the Owner. The defective materials and/or equipment shall be repaired or replaced, at the Owner's

TECHNICAL SPECIFICATIONS
ITEM L-108
UNDERGROUND POWER CABLE FOR AIRPORTS

discretion, with no additional cost to the Owner. The Contractor shall maintain a minimum insulation resistance in accordance with paragraph 108-3.10e with isolation transformers connected in new circuits and new segments of existing circuits through the end of the contract warranty period when tested in accordance with AC 150/5340-26, *Maintenance Airport Visual Aid Facilities*, paragraph 5.1.3.1, Insulation Resistance Test.

108-2.2 Cable. Underground cable for airfield lighting facilities (runway and taxiway lights and signs) shall conform to the requirements of AC 150/5345-7, Specification for L-824 Underground Electrical Cable for Airport Lighting Circuits latest edition. Conductors for use on 6.6 ampere primary airfield lighting series circuits shall be single conductor, seven strand, #8 American wire gauge (AWG), L-824 Type C, 5,000 volts, non-shielded, with cross-linked polyethylene insulation. Conductors for use on 20 ampere primary airfield lighting series circuits shall be single conductor, seven strand, #6 AWG, L-824 Type C, 5,000 volts, non-shielded, with cross-linked polyethylene insulation. L-824 conductors for use on the L-830 secondary of airfield lighting series circuits shall be sized in accordance with the manufacturer's recommendations. All other conductors shall comply with FAA and National Electric Code (NEC) requirements. Conductor sizes noted above shall not apply to leads furnished by manufacturers on airfield lighting transformers and fixtures.

Wire for electrical circuits up to 600 volts shall comply with Specification L-824 and/or Commercial Item Description A-A-59544A and shall be type THWN-2, 75°C for installation in conduit and RHW-2, 75°C for direct burial installations. Conductors for parallel (voltage) circuits shall be type and size and installed in accordance with NFPA-70, National Electrical Code.

Unless noted otherwise, all 600-volt and less non-airfield lighting conductor sizes are based on a 75°C, THWN-2, 600-volt insulation, copper conductors, not more than three single insulated conductors, in raceway, in free air. The conduit/duct sizes are based on the use of THWN-2, 600-volt insulated conductors. The Contractor shall make the necessary increase in conduit/duct sizes for other types of wire insulation. In no case shall the conduit/duct size be reduced. The minimum power circuit wire size shall be #12 AWG.

Conductor sizes may have been adjusted due to voltage drop or other engineering considerations. Equipment provided by the Contractor shall be capable of accepting the quantity and sizes of conductors shown in the Contract Documents. All conductors, pigtails, cable step-down adapters, cable step-up adapters, terminal blocks and splicing materials necessary to complete the cable termination/splice shall be considered incidental to the respective pay items provided.

Cable type, size, number of conductors, strand and service voltage shall be as specified in the Contract Document.

108-2.3 Bare copper wire (counterpoise, bare copper wire ground and ground rods). Wire for counterpoise or ground installations for airfield lighting systems shall be No. 6 AWG bare solid copper wire for counterpoise and/or No. 6 AWG insulated stranded for grounding bond wire per ASTM B3 and ASTM B8, and shall be bare copper wire. For voltage powered circuits, the equipment grounding conductor shall comply with NEC Article 250.

Ground rods shall be copper-clad steel. The ground rods shall be of the length and diameter specified on the plans, but in no case be less than 8 feet long and 5/8 inch in diameter.

108-2.4 Cable connections. In-line connections or splices of underground primary cables shall be of the type called for on the plans, and shall be one of the types listed below. No separate payment will be made for cable connections.

a. The cast splice. A cast splice, employing a plastic mold and using epoxy resin equivalent to that manufactured by 3M™ Company, "Scotchcast" Kit No. 82-B, or an approved equivalent, used for potting the splice is acceptable.

b. The field-attached plug-in splice. Field attached plug-in splices shall be installed as shown on the plans. The Contractor shall determine the outside diameter of the cable to be spliced and furnish appropriately sized connector kits and/or adapters. Tape or heat shrink tubing with integral sealant shall be in accordance with the manufacturer's requirements. Primary Connector Kits manufactured by Amerace, "Super Kit", Integro "Complete Kit", or approved equal is acceptable.

c. The factory-molded plug-in splice. Specification for L-823 Connectors, Factory-Molded to Individual Conductors, is acceptable.

d. The taped or heat-shrink splice. Taped splices employing field-applied rubber, or synthetic rubber tape covered with plastic tape is acceptable. The rubber tape should meet the requirements of ASTM D4388 and the plastic tape should comply with Military Specification MIL-I-24391 or Commercial Item Description A-A-55809. Heat shrinkable tubing shall be heavy-wall, self-sealing tubing rated for the voltage of the wire being spliced and suitable for direct-buried installations. The tubing shall be factory coated with a thermoplastic adhesive-sealant that will adhere to the insulation of the wire being spliced forming a moisture- and dirt-proof seal. Additionally, heat shrinkable tubing for multi-conductor cables, shielded cables, and armored cables shall be factory kits that are designed for the application. Heat shrinkable tubing and tubing kits shall be manufactured by Tyco Electronics/ Raychem Corporation, Energy Division, or approved equivalent.

In all the above cases, connections of cable conductors shall be made using crimp connectors using a crimping tool designed to make a complete crimp before the tool can be removed. All L-823/L-824 splices and terminations shall be made per the manufacturer's recommendations and listings.

All connections of counterpoise, grounding conductors and ground rods shall be made by the exothermic process or approved equivalent, except that a light base ground clamp connector shall be used for attachment to the light base. All exothermic connections shall be made per the manufacturer's recommendations and listings.

108-2.5 Splicer qualifications. Every airfield lighting cable splicer shall be qualified in making airport cable splices and terminations on cables rated at or above 5,000 volts AC. The Contractor shall submit to the RPR proof of the qualifications of each proposed cable splicer for the airport cable type and voltage level to be worked on. Cable splicing/terminating personnel shall have a minimum of three (3) years continuous experience in terminating/splicing medium voltage cable.

108-2.6 Concrete. Concrete shall be proportioned, placed, and cured per Item P-610, Concrete for Miscellaneous Structures.

108-2.7 Flowable backfill. Flowable material used to backfill trenches for power cable trenches shall conform to the requirements of Item P-153, Controlled Low Strength Material.

108-2.8 Cable identification tags. Cable identification tags shall be made from a non-corrosive material with the circuit identification stamped or etched onto the tag. The tags shall be of the type as detailed on the plans.

108-2.9 Tape. Electrical tapes shall be Scotch™ Electrical Tapes –Scotch™ 88 (1-1/2 inch wide) and Scotch™ 130C® linerless rubber splicing tape (2-inch wide), as manufactured by the Minnesota Mining and Manufacturing Company (3M™), or an approved equivalent.

108-2.10 Electrical coating. Electrical coating shall be Scotchkote™ as manufactured by 3M™, or an approved equivalent.

108-2.11 Existing circuits. Whenever the scope of work requires connection to an existing circuit, the existing circuit's insulation resistance shall be tested, in the presence of the RPR. The test shall be performed per this item and prior to any activity that will affect the respective circuit. The Contractor shall record the results on forms acceptable to the RPR. When the work affecting the circuit is complete, the circuit's insulation resistance shall be checked again, in the presence of the RPR. The Contractor shall

record the results on forms acceptable to the RPR. The second reading shall be equal to or greater than the first reading or the Contractor shall make the necessary repairs to the existing circuit to bring the second reading above the first reading. All repair costs including a complete replacement of the L-823 connectors, L-830 transformers and L-824 cable, if necessary, shall be borne by the Contractor. All test results shall be submitted in the Operation and Maintenance (O&M) Manual.

108-2.12 Detectable warning tape. Plastic, detectable, American Public Works Association (APWA) Red (electrical power lines, cables, conduit and lighting cable) with continuous legend tape shall be polyethylene film with a metalized foil core and shall be 3-6 inches wide. Detectable tape is incidental to the respective bid item. Detectable warning tape for communication cables shall be orange. Detectable warning tape color code shall comply with the APWA Uniform Color Code.

CONSTRUCTION METHODS

108-3.1 General. The Contractor shall install the specified cable at the approximate locations indicated on the plans. Unless otherwise shown on the plans, all cable required to cross under pavements expected to carry aircraft loads shall be installed in concrete encased duct banks. Cable shall be run without splices, from fixture to fixture.

Cable connections between lights will be permitted only at the light locations for connecting the underground cable to the primary leads of the individual isolation transformers. The Contractor shall be responsible for providing cable in continuous lengths for home runs or other long cable runs without connections unless otherwise authorized in writing by the RPR or shown on the plans.

In addition to connectors being installed at individual isolation transformers, L-823 cable connectors for maintenance and test points shall be installed at locations shown on the plans. Cable circuit identification markers shall be installed on both sides of the L-823 connectors installed and on both sides of slack loops where a future connector would be installed.

Provide not less than 3 feet of cable slack on each side of all connections, isolation transformers, light units, and at points where cable is connected to field equipment. Where provisions must be made for testing or for future above grade connections, provide enough slack to allow the cable to be extended at least one foot vertically above the top of the access structure. This requirement also applies where primary cable passes through empty light bases, junction boxes, and access structures to allow for future connections, or as designated by the RPR.

Primary airfield lighting cables installed shall have cable circuit identification markers attached on both sides of each L-823 connector and on each airport lighting cable entering or leaving cable access points, such as manholes, hand holes, pull boxes, junction boxes, etc. Markers shall be of sufficient length for imprinting the cable circuit identification legend on one line, using letters not less than 1/4 inch in size. The cable circuit identification shall match the circuits noted on the construction plans.

108-3.2 Installation in duct banks or conduits. This item includes the installation of the cable in duct banks or conduit per the following paragraphs. The maximum number and voltage ratings of cables installed in each single duct or conduit, and the current-carrying capacity of each cable shall be per the latest version of the National Electric Code, or the code of the local agency or authority having jurisdiction.

The Contractor shall make no connections or splices of any kind in cables installed in conduits or duct banks.

Unless otherwise designated in the plans, where ducts are in tiers, use the lowest ducts to receive the cable first, with spare ducts left in the upper levels. Check duct routes prior to construction to obtain assurance that the shortest routes are selected and that any potential interference is avoided.

Duct banks or conduits shall be installed as a separate item per Item L-110, Airport Underground Electrical Duct Banks and Conduit. The Contractor shall run a mandrel through duct banks or conduit prior to installation of cable to ensure that the duct bank or conduit is open, continuous and clear of debris. The mandrel size shall be compatible with the conduit size. The Contractor shall swab out all conduits/ducts and clean light bases, manholes, etc., interiors immediately prior to pulling cable. Once cleaned and swabbed, the light bases and all accessible points of entry to the duct/conduit system shall be kept closed except when installing cables. Cleaning of ducts, light bases, manholes, etc., is incidental to the pay item of the item being cleaned. All raceway systems left open, after initial cleaning, for any reason shall be re-cleaned at the Contractor's expense. The Contractor shall verify existing ducts proposed for use in this project as clear and open. The Contractor shall notify the RPR of any blockage in the existing ducts.

The cable shall be installed in a manner that prevents harmful stretching of the conductor, damage to the insulation, or damage to the outer protective covering. The ends of all cables shall be sealed with moisture-seal tape providing moisture-tight mechanical protection with minimum bulk, or alternately, heat shrinkable tubing before pulling into the conduit and it shall be left sealed until connections are made. Where more than one cable is to be installed in a conduit, all cable shall be pulled in the conduit at the same time. The pulling of a cable through duct banks or conduits may be accomplished by hand winch or power winch with the use of cable grips or pulling eyes. Maximum pulling tensions shall not exceed the cable manufacturer's recommendations. A non-hardening cable-pulling lubricant recommended for the type of cable being installed shall be used where required.

The Contractor shall submit the recommended pulling tension values to the RPR prior to any cable installation. If required by the RPR, pulling tension values for cable pulls shall be monitored by a dynamometer in the presence of the RPR. Cable pull tensions shall be recorded by the Contractor and reviewed by the RPR. Cables exceeding the maximum allowable pulling tension values shall be removed and replaced by the Contractor at the Contractor's expense.

The manufacturer's minimum bend radius or NEC requirements (whichever is more restrictive) shall apply. Cable installation, handling and storage shall be per manufacturer's recommendations. During cold weather, particular attention shall be paid to the manufacturer's minimum installation temperature. Cable shall not be installed when the temperature is at or below the manufacturer's minimum installation temperature. At the Contractor's option, the Contractor may submit a plan, for review by the RPR, for heated storage of the cable and maintenance of an acceptable cable temperature during installation when temperatures are below the manufacturer's minimum cable installation temperature.

Cable shall not be dragged across base can or manhole edges, pavement or earth. When cable must be coiled, lay cable out on a canvas tarp or use other appropriate means to prevent abrasion to the cable jacket.

108-3.3 Installation of direct-buried cable in trenches. Unless otherwise specified, the Contractor shall not use a cable plow for installing the cable. Cable shall be unreeled uniformly in place alongside or in the trench and shall be carefully placed along the bottom of the trench. The cable shall not be unreeled and pulled into the trench from one end. Slack cable sufficient to provide strain relief shall be placed in the trench in a series of S curves. Sharp bends or kinks in the cable shall not be permitted.

Where cables must cross over each other, a minimum of 3 inches vertical displacement shall be provided with the topmost cable depth at or below the minimum required depth below finished grade.

a. Trenching. Where turf is well established and the sod can be removed, it shall be carefully stripped and properly stored. Trenches for cables may be excavated manually or with mechanical trenching equipment. Walls of trenches shall be essentially vertical so that a minimum of surface is disturbed. Graders shall not be used to excavate the trench with their blades. The bottom surface of trenches shall be essentially smooth and free from coarse aggregate. Unless otherwise specified, cable

TECHNICAL SPECIFICATIONS
ITEM L-108
UNDERGROUND POWER CABLE FOR AIRPORTS

trenches shall be excavated to a minimum depth of 18 inches below finished grade per NEC Table 300.5, except as follows:

- When off the airport or crossing under a roadway or driveway, the minimum depth shall be 36 inches unless otherwise specified.
- Minimum cable depth when crossing under a railroad track, shall be 42 inches unless otherwise specified.

The Contractor shall excavate all cable trenches to a width not less than 6 inches. Unless otherwise specified on the plans, all cables in the same location and running in the same general direction shall be installed in the same trench.

When rock is encountered, the rock shall be removed to a depth of at least 3 inches below the required cable depth and it shall be replaced with bedding material of earth or sand containing no mineral aggregate particles that would be retained on a 1/4-inch sieve. Flowable backfill material may alternatively be used.

Duct bank or conduit markers temporarily removed for trench excavations shall be replaced as required.

It is the Contractor's responsibility to locate existing utilities within the work area prior to excavation. Where existing active cables cross proposed installations, the Contractor shall ensure that these cables are adequately protected. Where crossings are unavoidable, no splices will be allowed in the existing cables, except as specified on the plans. Installation of new cable where such crossings must occur shall proceed as follows:

(1) Existing cables shall be located manually. Unearthed cables shall be inspected to assure absolutely no damage has occurred.

(2) Trenching, etc., in cable areas shall then proceed, with approval of the RPR, with care taken to minimize possible damage or disruption of existing cable, including careful backfilling in area of cable.

In the event that any previously identified cable is damaged during the course of construction, the Contractor shall be responsible for the complete repair or replacement.

b. Backfilling. After the cable has been installed, the trench shall be backfilled. The first layer of backfill in the trench shall encompass all cables; be 3 inches deep, loose measurement; and shall be either earth or sand containing no mineral aggregate particles that would be retained on a 1/4-inch sieve. This layer shall not be compacted. The second layer shall be 5 inches deep, loose measurement, and shall contain no particles that would be retained on a one inch sieve. The remaining third and subsequent layers of backfill shall not exceed 8 inches of loose measurement and be excavated or imported material and shall not contain stone or aggregate larger than 4 inches maximum diameter.

The second and subsequent layers shall be thoroughly tamped and compacted to at least the density of the adjacent material. If the cable is to be installed in locations or areas where other compaction requirements are specified (under pavements, embankments, etc.) the backfill compaction shall be to a minimum of 100 percent of ASTM D1557.

Trenches shall not contain pools of water during backfilling operations. The trench shall be completely backfilled and tamped level with the adjacent surface, except that when turf is to be established over the trench, the backfilling shall be stopped at an appropriate depth consistent with the type of turving operation to be accommodated. A proper allowance for settlement shall also be provided. Any excess excavated material shall be removed and disposed of per the plans and specifications.

Underground electrical warning (caution) tape shall be installed in the trench above all direct-buried cable. Contractor shall submit a sample of the proposed warning tape for acceptance by the RPR. If not shown on the plans, the warning tape shall be located 6 inches above the direct-buried cable or the

counterpoise wire if present. A 3-6 inch wide polyethylene film detectable tape, with a metalized foil core, shall be installed above all direct buried cable or counterpoise. The tape shall be of the color and have a continuous legend as indicated on the plans. The tape shall be installed 8 inches minimum below finished grade.

c. Restoration. Following restoration of all trenching near airport movement surfaces, the Contractor shall visually inspect the area for foreign object debris (FOD) and remove any that is found. Where soil and sod has been removed, it shall be replaced as soon as possible after the backfilling is completed. All areas disturbed by work shall be restored to its original condition. The restoration shall include the sodding, topsoiling, fertilizing, liming, and seeding as shown on the plans. The Contractor shall be held responsible for maintaining all disturbed surfaces and replacements until final acceptance. When trenching is through paved areas, restoration shall be equal to existing conditions. If the cable is to be installed in locations or areas where other compaction requirements are specified (under pavements, embankments, etc.) the backfill compaction shall be to a minimum of 100 percent of ASTM D1557. Restoration shall be considered incidental to the pay item of which it is a component part.

108-3.4 Cable markers for direct-buried cable. The location of direct buried circuits shall be marked by a concrete slab marker, 2 feet square and 4-6 inch thick, extending approximately one inch above the surface. Each cable run from a line of lights and signs to the equipment vault shall be marked at approximately every 200 feet along the cable run, with an additional marker at each change of direction of cable run. All other direct-buried cable shall be marked in the same manner. Cable markers shall be installed directly above the cable. The Contractor shall impress the word "CABLE" and directional arrows on each cable marking slab. The letters shall be approximately 4 inches high and 3 inches wide, with width of stroke 1/2 inch and 1/4 inch deep. Stencils shall be used for cable marker lettering; no hand lettering shall be permitted.

At the location of each underground cable connection/splice, except at lighting units, or isolation transformers, a concrete marker slab shall be installed to mark the location of the connection/splice. The Contractor shall impress the word "SPLICE" on each slab. The Contractor also shall impress additional circuit identification symbols on each slab as directed by the RPR. All cable markers and splice markers shall be painted international orange. Paint shall be specifically manufactured for uncured exterior concrete. After placement, all cable or splice markers shall be given one coat of high-visibility aviation orange paint as approved by the RPR. Furnishing and installation of cable markers is incidental to the respective cable pay item.

108-3.5 Splicing. Connections of the type shown on the plans shall be made by experienced personnel regularly engaged in this type of work and shall be made as follows:

a. Cast splices. These shall be made by using crimp connectors for jointing conductors. Molds shall be assembled, and the compound shall be mixed and poured per the manufacturer's instructions and to the satisfaction of the RPR.

b. Field-attached plug-in splices. These shall be assembled per the manufacturer's instructions. These splices shall be made by plugging directly into mating connectors. The joint where the connectors come together shall be finished by one of the following methods: (1) wrapped with at least one layer of rubber or synthetic rubber tape and one layer of plastic tape, one-half lapped, extending at least 1-1/2 inches on each side of the joint (2) Covered with heat shrinkable tubing with integral sealant extending at least 1-1/2 inches on each side of the joint or (3) On connector kits equipped with water seal flap; roll-over water seal flap to sealing position on mating connector.

c. Factory-molded plug-in splices. These shall be made by plugging directly into mating connectors. The joint where the connectors come together shall be finished by one of the following methods: (1) Wrapped with at least one layer of rubber or synthetic rubber tape and one layer of plastic tape, one-half lapped, extending at least 1-1/2 inches on each side of the joint. (2) Covered with heat shrinkable tubing

with integral sealant extending at least 1-1/2 inches on each side of the joint. or (3) On connector kits so equipped with water seal flap; roll-over water seal flap to sealing position on mating connector.

d. Taped or heat-shrink splices. A taped splice shall be made in the following manner:

Bring the cables to their final position and cut so that the conductors will butt. Remove insulation and jacket allowing for bare conductor of proper length to fit compression sleeve connector with 1/4 inch of bare conductor on each side of the connector. Prior to splicing, the two ends of the cable insulation shall be penciled using a tool designed specifically for this purpose and for cable size and type. Do not use emery paper on splicing operation since it contains metallic particles. The copper conductors shall be thoroughly cleaned. Join the conductors by inserting them equidistant into the compression connection sleeve. Crimp conductors firmly in place with crimping tool that requires a complete crimp before tool can be removed. Test the crimped connection by pulling on the cable. Scrape the insulation to assure that the entire surface over which the tape will be applied (plus 3 inches on each end) is clean. After scraping, wipe the entire area with a clean lint-free cloth. Do not use solvents.

Apply high-voltage rubber tape one-half lapped over bare conductor. This tape should be tensioned as recommended by the manufacturer. Voids in the connector area may be eliminated by highly elongating the tape, stretching it just short of its breaking point. The manufacturer's recommendation for stretching tape during splicing shall be followed. Always attempt to exactly half-lap to produce a uniform buildup. Continue buildup to 1-1/2 times cable diameter over the body of the splice with ends tapered a distance of approximately one inch over the original jacket. Cover rubber tape with two layers of vinyl pressure-sensitive tape one-half lapped. Do not use glyptol or lacquer over vinyl tape as they react as solvents to the tape. No further cable covering or splice boxes are required.

Heat shrinkable tubing shall be installed following manufacturer's instructions. Direct flame heating shall not be permitted unless recommended by the manufacturer. Cable surfaces within the limits of the heat-shrink application shall be clean and free of contaminants prior to application.

e. Assembly. Surfaces of equipment or conductors being terminated or connected shall be prepared in accordance with industry standard practice and manufacturer's recommendations. All surfaces to be connected shall be thoroughly cleaned to remove all dirt, grease, oxides, nonconductive films, or other foreign material. Paints and other nonconductive coatings shall be removed to expose base metal. Clean all surfaces at least 1/4 inch beyond all sides of the larger bonded area on all mating surfaces. Use a joint compound suitable for the materials used in the connection. Repair painted/coated surface to original condition after completing the connection.

108-3.6 Bare counterpoise wire installation for lightning protection and grounding. If shown on the plans or included in the job specifications, bare solid #6 AWG copper counterpoise wire shall be installed for lightning protection of the underground cables. The RPR shall select one of two methods of lightning protection for the airfield lighting circuit based upon sound engineering practice and lightning strike density.

a. Equipotential. May be used by the RPR for areas that have high rates of lightning strikes. The counterpoise size is as shown on the plans. The equipotential method is applicable to all airfield lighting systems; i.e. runway, taxiway, apron – touchdown zone, centerline, edge, threshold and approach lighting systems. The equipotential method is also successfully applied to provide lightning protection for power, signal and communication systems. The light bases, counterpoise, etc – all components - are bonded together and bonded to the vault power system ground loop/electrode.

Counterpoise wire shall be installed in the same trench for the entire length of buried cable, conduits and duct banks that are installed to contain airfield cables. The counterpoise is centered over the cable/conduit/duct to be protected.

The counterpoise conductor shall be installed no less than 8 inches minimum or 12 inches maximum above the raceway or cable to be protected, except as permitted below:

(1) The minimum counterpoise conductor height above the raceway or cable to be protected shall be permitted to be adjusted subject to coordination with the airfield lighting and pavement designs.

(2) The counterpoise conductor height above the protected raceway(s) or cable(s) shall be calculated to ensure that the raceway or cable is within a 45-degree area of protection, (45 degrees on each side of vertical creating a 90 degree angle).

The counterpoise conductor shall be bonded to each metallic light base, mounting stake, and metallic airfield lighting component.

All metallic airfield lighting components in the field circuit on the output side of the constant current regulator (CCR) or other power source shall be bonded to the airfield lighting counterpoise system.

All components rise and fall at the same potential; with no potential difference, no damaging arcing and no damaging current flow.

See AC 150/5340-30, Design and Installation Details for Airport Visual Aids and NFPA 780, Standard for the Installation of Lightning Protection Systems, Chapter 11, for a detailed description of the Equipotential Method of lightning protection.

Reference FAA STD-019E, Lightning and Surge Protection, Grounding Bonding and Shielding Requirements for Facilities and Electronic Equipment, Part 4.1.1.7.

b. Isolation. Used in areas where lightning strikes are not common. Counterpoise size is as shown on the plans. The isolation method is an alternate method for use only with edge lights installed in turf and stabilized soils and raceways installed parallel to and adjacent to the edge of the pavement. NFPA 780 uses 15 feet to define "adjacent to".

The counterpoise conductor shall be installed halfway between the pavement edge and the light base, mounting stake, raceway, or cable being protected.

The counterpoise conductor shall be installed 8 inches minimum below grade. The counterpoise is not connected to the light base or mounting stake. An additional grounding electrode is required at each light base or mounting stake. The grounding electrode is bonded to the light base or mounting stake with a 6 AWG solid copper conductor.

See AC 150/5340-30, Design and Installation Details for Airport Visual Aids and NFPA 780, Standard for the Installation of Lightning Protection Systems, Chapter 11, for a detailed description of the Isolation Method of lightning protection.

c. Common Installation requirements. When a metallic light base is used, the grounding electrode shall be bonded to the metallic light base or mounting stake with a No. 6 AWG bare, annealed or soft drawn, solid copper conductor.

When a nonmetallic light base is used, the grounding electrode shall be bonded to the metallic light fixture or metallic base plate with a No. 6 AWG bare, annealed or soft drawn, solid copper conductor.

Grounding electrodes may be rods, ground dissipation plates, radials, or other electrodes listed in the NFPA 70 (NEC) or NFPA 780.

Where raceway is installed by the directional bore, jack and bore, or other drilling method, the counterpoise conductor shall be permitted to be installed concurrently with the directional bore, jack and bore, or other drilling method raceway, external to the raceway or sleeve.

The counterpoise wire shall also be exothermically welded to ground rods installed as shown on the plans but not more than 500 feet (150 m) apart around the entire circuit. The counterpoise system shall be

continuous and terminate at the transformer vault or at the power source. It shall be securely attached to the vault or equipment external ground ring or other made electrode-grounding system. The connections shall be made as shown on the plans and in the specifications.

Where an existing airfield lighting system is being extended or modified, the new counterpoise conductors shall be interconnected to existing counterpoise conductors at each intersection of the new and existing airfield lighting counterpoise systems.

d. Parallel Voltage Systems. Provide grounding and bonding in accordance with NFPA 70, National Electrical Code.

108-3.7 Counterpoise installation above multiple conduits and duct banks. Counterpoise wires shall be installed above multiple conduits/duct banks for airfield lighting cables, with the intent being to provide a complete area of protection over the airfield lighting cables. When multiple conduits and/or duct banks for airfield cable are installed in the same trench, the number and location of counterpoise wires above the conduits shall be adequate to provide a complete area of protection measured 45 degrees each side of vertical.

Where duct banks pass under pavement to be constructed in the project, the counterpoise shall be placed above the duct bank. Reference details on the construction plans.

108-3.8 Counterpoise installation at existing duct banks. When airfield lighting cables are indicated on the plans to be routed through existing duct banks, the new counterpoise wiring shall be terminated at ground rods at each end of the existing duct bank where the cables being protected enter and exit the duct bank. The new counterpoise conductor shall be bonded to the existing counterpoise system.

108-3.9 Exothermic bonding. Bonding of counterpoise wire shall be by the exothermic welding process or equivalent method accepted by the RPR. Only personnel experienced in and regularly engaged in this type of work shall make these connections.

Contractor shall demonstrate to the satisfaction of the RPR, the welding kits, materials and procedures to be used for welded connections prior to any installations in the field. The installations shall comply with the manufacturer's recommendations and the following:

a. All slag shall be removed from welds.

b. Using an exothermic weld to bond the counterpoise to a lug on a galvanized light base is not recommended unless the base has been specially modified. Consult the manufacturer's installation directions for proper methods of bonding copper wire to the light base. See AC 150/5340-30 for galvanized light base exception.

c. If called for in the plans, all buried copper and weld material at weld connections shall be thoroughly coated with 6 mm of 3M™ Scotchkote™, or approved equivalent, or coated with coal tar Bitumastic® material to prevent surface exposure to corrosive soil or moisture.

108-3.10 Testing. The Contractor shall furnish all necessary equipment and appliances for testing the airport electrical systems and underground cable circuits before and after installation. The Contractor shall perform all tests in the presence of the RPR. The Contractor shall demonstrate the electrical characteristics to the satisfaction of the RPR. All costs for testing are incidental to the respective item being tested. For phased projects, the tests must be completed by phase. The Contractor must maintain the test results throughout the entire project as well as during the warranty period that meet the following:

a. Earth resistance testing methods shall be submitted to the RPR for approval. Earth resistance testing results shall be recorded on an approved form and testing shall be performed in the presence of the RPR. All such testing shall be at the sole expense of the Contractor.

b. Should the counterpoise or ground grid conductors be damaged or suspected of being damaged by construction activities the Contractor shall test the conductors for continuity with a low resistance

ohmmeter. The conductors shall be isolated such that no parallel path exists and tested for continuity. The RPR shall approve of the test method selected. All such testing shall be at the sole expense of the Contractor.

After installation, the Contractor shall test and demonstrate to the satisfaction of the RPR the following:

- c. That all affected lighting power and control circuits (existing and new) are continuous and free from short circuits.
- d. That all affected circuits (existing and new) are free from unspecified grounds.
- e. That the insulation resistance to ground of all new non-grounded high voltage series circuits or cable segments is not less than 50 megohms. Verify continuity of all series airfield lighting circuits prior to energization.
- f. That the insulation resistance to ground of all new non-grounded conductors of new multiple circuits or circuit segments is not less than 100 megohms.
- g. That all affected circuits (existing and new) are properly connected per applicable wiring diagrams.
- h. That all affected circuits (existing and new) are operable. Tests shall be conducted that include operating each control not less than 10 times and the continuous operation of each lighting and power circuit for not less than 1/2 hour.
- i. That the impedance to ground of each ground rod does not exceed 25 ohms prior to establishing connections to other ground electrodes. The fall-of-potential ground impedance test shall be used, as described by American National Standards Institute/Institute of Electrical and Electronic Engineers (ANSI/IEEE) Standard 81, to verify this requirement. As an alternate, clamp-on style ground impedance test meters may be used to satisfy the impedance testing requirement. Test equipment and its calibration sheets shall be submitted for review and approval by the RPR prior to performing the testing.

Two copies of tabulated results of all cable tests performed shall be supplied by the Contractor to the RPR. Where connecting new cable to existing cable, insulation resistance tests shall be performed on the new cable prior to connection to the existing circuit.

There are no approved "repair" procedures for items that have failed testing other than complete replacement.

METHOD OF MEASUREMENT

108-4.1 Cable trench associated with duct banks shall not be paid for under this item, but shall be included in the unit price for duct banks in specification L-110. Cable trench associated with the installation of counterpoise in a separate trench shall not be paid under this item, but shall be considered incidental to the unit price in a separate trench shall not be paid under this item, but shall be considered incidental to the unit price for the counterpoise.

108-4.2 Cable or counterpoise wire installed in trench, duct bank or conduit shall be measured by the number of linear feet of cable or counterpoise wire installed in trenches, duct bank or conduit, including ground rods installed and grounding connectors, and trench marking tape ready for operation, and accepted as satisfactory. Separate measurement shall be made for each cable or counterpoise wire installed in trench, duct bank or conduit. The measurement for this item shall not include additional quantities required for slack.

108-4.3 No separate payment will be made for ground rods.

BASIS OF PAYMENT

108-5.1 Payment will be made at the contract unit price for cable and bare counterpoise wire installed in trench (direct-buried), or cable and equipment ground installed in duct bank or conduit, in place by the Contractor and accepted by the RPR. This price shall be full compensation for furnishing all materials and for all preparation and installation of these materials, and for all labor, equipment, tools, and incidentals, including ground rods and ground connectors and trench marking tape, necessary to complete this item.

Payment will be made under:

Item L-108-5.1	No. 8 AWG, 5 kV, L-824, Type C Cable, Installed in Trench, Duct Bank or Conduit - per liner foot
Item L-108-5.2	No. 6 AWG, Solid, Bare Copper Counterpoise Wire, Installed in Trench, Including Connections/Terminations - per linear foot

REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

Advisory Circulars (AC)

AC 150/5340-26	Maintenance of Airport Visual Aid Facilities
AC 150/5340-30	Design and Installation Details for Airport Visual Aids
AC 150/5345-7	Specification for L-824 Underground Electrical Cable for Airport Lighting Circuits
AC 150/5345-26	Specification for L-823 Plug and Receptacle, Cable Connectors
AC 150/5345-53	Airport Lighting Equipment Certification Program

Commercial Item Description

A-A-59544A	Cable and Wire, Electrical (Power, Fixed Installation)
A-A-55809	Insulation Tape, Electrical, Pressure-Sensitive Adhesive, Plastic

ASTM International (ASTM)

ASTM B3	Standard Specification for Soft or Annealed Copper Wire
ASTM B8	Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
ASTM B33	Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes
ASTM D4388	Standard Specification for Nonmetallic Semi-Conducting and Electrically Insulating Rubber Tapes

Mil Spec

MIL-PRF-23586F	Performance Specification: Sealing Compound (with Accelerator), Silicone Rubber, Electrical
MIL-I-24391	Insulation Tape, Electrical, Plastic, Pressure Sensitive

**TECHNICAL SPECIFICATIONS
ITEM L-108
UNDERGROUND POWER CABLE FOR AIRPORTS**

National Fire Protection Association (NFPA)

NFPA-70 National Electrical Code (NEC)

NFPA-780 Standard for the Installation of Lightning Protection Systems

American National Standards Institute (ANSI)/Institute of Electrical and Electronics Engineers (IEEE)

ANSI/IEEE STD 81 IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and
Earth Surface Potentials of a Ground System

Federal Aviation Administration Standard

FAA STD-019E Lightning and Surge Protection, Grounding Bonding and Shielding
Requirements for Facilities and Electronic Equipment

END OF ITEM L-108

BASIS OF PAYMENT

125-5.1 Payment will be made at the Contract unit price for each complete runway or taxiway light, guidance sign installed by the Contractor and accepted by the RPR. This payment will be full compensation for furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools and incidentals necessary to complete this item.

Payment will be made under:

Item L-125-5.1	Install New Runway Edge Light L-862 – LED Lamp w/arctic kit, Base Mounted - per each
Item L-125-5.2	Relocate Existing Guidance Sign on New Foundation – per each
Item L-125-5.3	Install New Guidance Sign – per each
Item L-125-5.4	L-893 Runway Closure Markers – per each
Item L-125-5.5	Install New Taxiway Edge Light L-861T –LED lamp w/arctic kit
Item L-125-5.6	Install New Taxiway Edge Light L-861T –Quartz lamp
Item L-125-5.7	Install New In-Pavement LED Runway Edge Light L-850 - per each

REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

Advisory Circulars (AC)

AC 150/5340-18	Standards for Airport Sign Systems
AC 150/5340-26	Maintenance of Airport Visual Aid Facilities
AC 150/5340-30	Design and Installation Details for Airport Visual Aids
AC 150/5345-5	Circuit Selector Switch
AC 150/5345-7	Specification for L-824 Underground Electrical Cable for Airport Lighting Circuits
AC 150/5345-26	Specification for L-823 Plug and Receptacle, Cable Connectors
AC 150/5345-28	Precision Approach Path Indicator (PAPI) Systems
AC 150/5345-39	Specification for L-853, Runway and Taxiway Retroreflective Markers
AC 150/5345-42	Specification for Airport Light Bases, Transformer Housings, Junction Boxes, and Accessories
AC 150/5345-44	Specification for Runway and Taxiway Signs
AC 150/5345-46	Specification for Runway and Taxiway Light Fixtures
AC 150/5345-47	Specification for Series to Series Isolation Transformers for Airport Lighting Systems
AC 150/5345-51	Specification for Discharge-Type Flashing Light Equipment
AC 150/5345-53	Airport Lighting Equipment Certification Program

BID PLANS
NOT FOR
CONSTRUCTION

ITEM NO.	SPEC. SECTION	DESCRIPTION	UNIT	TOTAL QUANTITY
FAA Pay Items				
1	C-102-5.1	TEMPORARY SEEDING AND MULCHING	AC	2
2	C-102-5.2	INSTALLATION AND REMOVAL OF SILT FENCE	LF	10,500
3	C-102-5.3	CATCH BASIN INLET PROTECTION	EA	19
4	C-102-5.4	EROSION CONTROL MATTING	SY	500
5	C-102-5.5	STABILIZED CONSTRUCTION ENTRANCE	EA	2
6	C-102-5.6	COMPOST FILTER TUBE	LF	2,650
7	P-150-5.1	PAVEMENT REMOVAL	SY	2,900
8	P-150-5.2	RUNWAY LIGHT REMOVAL	EA	79
9	P-150-5.3	TAXIWAY LIGHT REMOVAL	EA	100
10	P-150-5.4	GUIDANCE SIGN FOUNDATION REMOVAL	EA	11
11	P-150-5.5	PAVEMENT MARKING REMOVAL	SY	1,300
12	P-152-4.1	UNCLASSIFIED EXCAVATION	CY	10,400
13	P-207-5.1	IN-PLACE FDR RECYCLED ASPHALT AGGREGATE BASE COURSE	SY	46,800
14	P-207-5.2	CORRECTIVE AGGREGATE MATERIAL (1-1/2" CRUSHED STONE)	CY	4,200
15	P-207-5.3	REUSED FDR AGGREGATE BASE COURSE	CY	2,000
16	P-401-8.1	BITUMINOUS PAVEMENT - BINDER COURSE	TON	6,550
17	P-401-8.2	BITUMINOUS PAVEMENT - WEARING COURSE	TON	6,550
18	P-603-5.1	EMULSIFIED ASPHALT TACK COAT	GAL	2,500
19	P-605-5.1	JOINT SEALANT FOR PAVEMENTS	LF	1,500
20	P-620-5.1	WHITE PAINT	SF	48,100
21	P-620-5.2	BLACK PAINT	SF	27,500
22	P-620-5.3	YELLOW PAINT	SF	4,400
23	P-621-5.1	GROOVING	SY	27,400
24	T-901-5.1	SEEDING	AC	18
25	T-905-5.1	TOPSOILING (4")	CY	9,550
26	T-908-5.1	MULCHING	AC	18
27	L-108-5.1	NO. 8 AWG, L-824 CABLE	LF	20,700
28	L-108-5.2	NO. 6 BARE COUNTERPOISE WIRE	LF	19,700
29	L-110-5.1	4" 4-WAY CONCRETE ENCASED ELECTRICAL DUCT BANK	LF	480
30	L-110-5.2	2" ELECTRICAL CONDUIT	LF	20,300
31	L-110-5.3	CONCRETE DUCT OR SPLICE MARKER	EA	12
32	L-110-5.4	2" 1-WAY CONCRETE ENCASED ELECTRICAL DUCT BANK	LF	260
33	L-115-5.1	ELECTRIC HANDHOLE	EA	12
34	L-125-5.1	INSTALL RUNWAY EDGE LIGHT L-862	EA	64
35	L-125-5.2	RELOCATE GUIDANCE SIGN ON NEW FOUNDATION	EA	11
36	L-125-5.3	INSTALL NEW GUIDANCE SIGN	EA	12
37	L-125-5.4	L-893 RUNWAY CLOSURE MARKERS	EA	4
38	L-125-5.5	INSTALL NEW TAXIWAY EDGE LIGHT L-861T - LED	EA	74
39	L-125-5.6	INSTALL NEW TAXIWAY EDGE LIGHT L-861T - QUARTZ	EA	16
40	L-125-5.7	INSTALL NEW IN-PAVEMENT LED RUNWAY EDGE LIGHT L-850	EA	2

REVISIONS	REVISION DESCRIPTION	BY	DATE	NUMBER

CLIENT NAME:
PLYMOUTH AIRPORT
COMMISSION
246 SOUTH MEADOW
ROAD
PLYMOUTH, MASS.
02360

PROJECT NAME:
RECONSTRUCT,
MARK RUNWAY 6-24
(APPROX 4,350 LF X
75 LF)

AIP NO.
3-25-0042-XXX-2025

SHEET TITLE

QUANTITIES

D&K PROJECT #	PROJ. ENG.
331139	MCG


DRAWN BY	CHECKED BY
DSP	JAA

DATE
MARCH 2026

SHEET NUMBER

G1.5

SHEET: 5 of 79

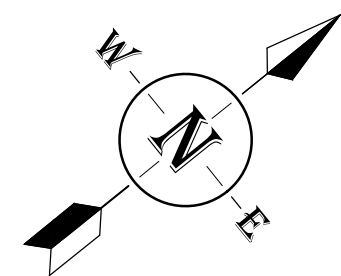

LEGEND

- ① WORK AREA INDICATOR
- ✕ CLOSED RUNWAY MARKER
- /— LOW PROFILE LIGHTED BARRICADE
- ↔ HAUL ROUTE
- - - AIRPORT PROPERTY LINE
- RSA — RUNWAY SAFETY AREA
- ROFA — RUNWAY OBJECT FREE AREA
- PROPOSED PAVEMENT
- ▨ PROPOSED PAVEMENT RECLAIM OR REMOVAL
- - - WORK AREA LIMITS

BID PLANS
NOT FOR CONSTRUCTION

REVISIONS	REVISION DESCRIPTION	
	NUMBER	DATE

WORK AREA 5

MAJOR WORK ITEMS

- PERFORM RUNWAY GROOVING OPERATIONS.
- INSTALL PERMANENT PAVEMENT MARKINGS.

WORK AREA 5 RESTRICTIONS ON CONSTRUCTION


- CONSTRUCTION OF WORK AREA INCLUDES:
 - RUNWAY GROOVING AND MARKING OPERATIONS.
- CONSTRUCTION ACTIVITIES ARE RESTRICTED TO BETWEEN 7:00 AM AND 7:00 PM MONDAY THROUGH SATURDAY. NO CONSTRUCTION MAY BE PERFORMED ON SUNDAY.
- WORK AREA 5A MAY BE WORKED ON CONCURRENTLY WITH WORK AREA 1, 4 AND 5D.
- WORK AREA 5A MAY NOT BE WORKED ON CONCURRENTLY WITH BOTH WORK AREAS 2, 3, 5B AND 5C.
- WORK AREA 5B MAY NOT BE WORKED ON CONCURRENTLY WITH WORK AREA 1, 3, 4, 5A, 5C, OR 5D.
- WORK AREA 5C MAY BE WORKED ON CONCURRENTLY WITH WORK AREA 3, 4, AND 5D.
- WORK AREA 5C MAY NOT BE WORKED ON CONCURRENTLY WITH WORK AREAS 1, 2, 5A, OR 5B.
- WORK AREA 5D MAY BE WORKED ON CONCURRENTLY WITH WORK AREAS 1, 3, 5A OR 5C.
- WORK AREA 5D MAY NOT BE WORKED ON CONCURRENTLY WITH WORK AREAS 2 OR 5B.

WORK AREA 5 NOTES:

LOCATION:
FULL LENGTH OF RUNWAY '6-24',
DURATION: 7 DAYS

AIRPORT AREAS IMPACTED:

- RUNWAY '6-24' SHALL BE CLOSED DURING CONSTRUCTION OF PHASE 5.
- A PORTION OF TAXIWAYS 'D' AND 'E' SHALL BE CLOSED DURING PHASE 5A.
- TAXIWAYS 'H', 'J', 'K' AND 'L' SHALL BE CLOSED DURING PHASE 5B. A PORTION OF TAXIWAYS 'E' AND 'S' SHALL BE CLOSED DURING PHASE 5B.
- RUNWAY 15-33 SHALL BE CLOSED DURING PHASE 5C. TAXIWAYS 'D', 'E', AND 'S' SHALL BE CLOSED DURING PHASE 5C.
- A PORTION OF TAXIWAYS 'E' AND 'D' SHALL BE CLOSED DURING PHASE 5D.

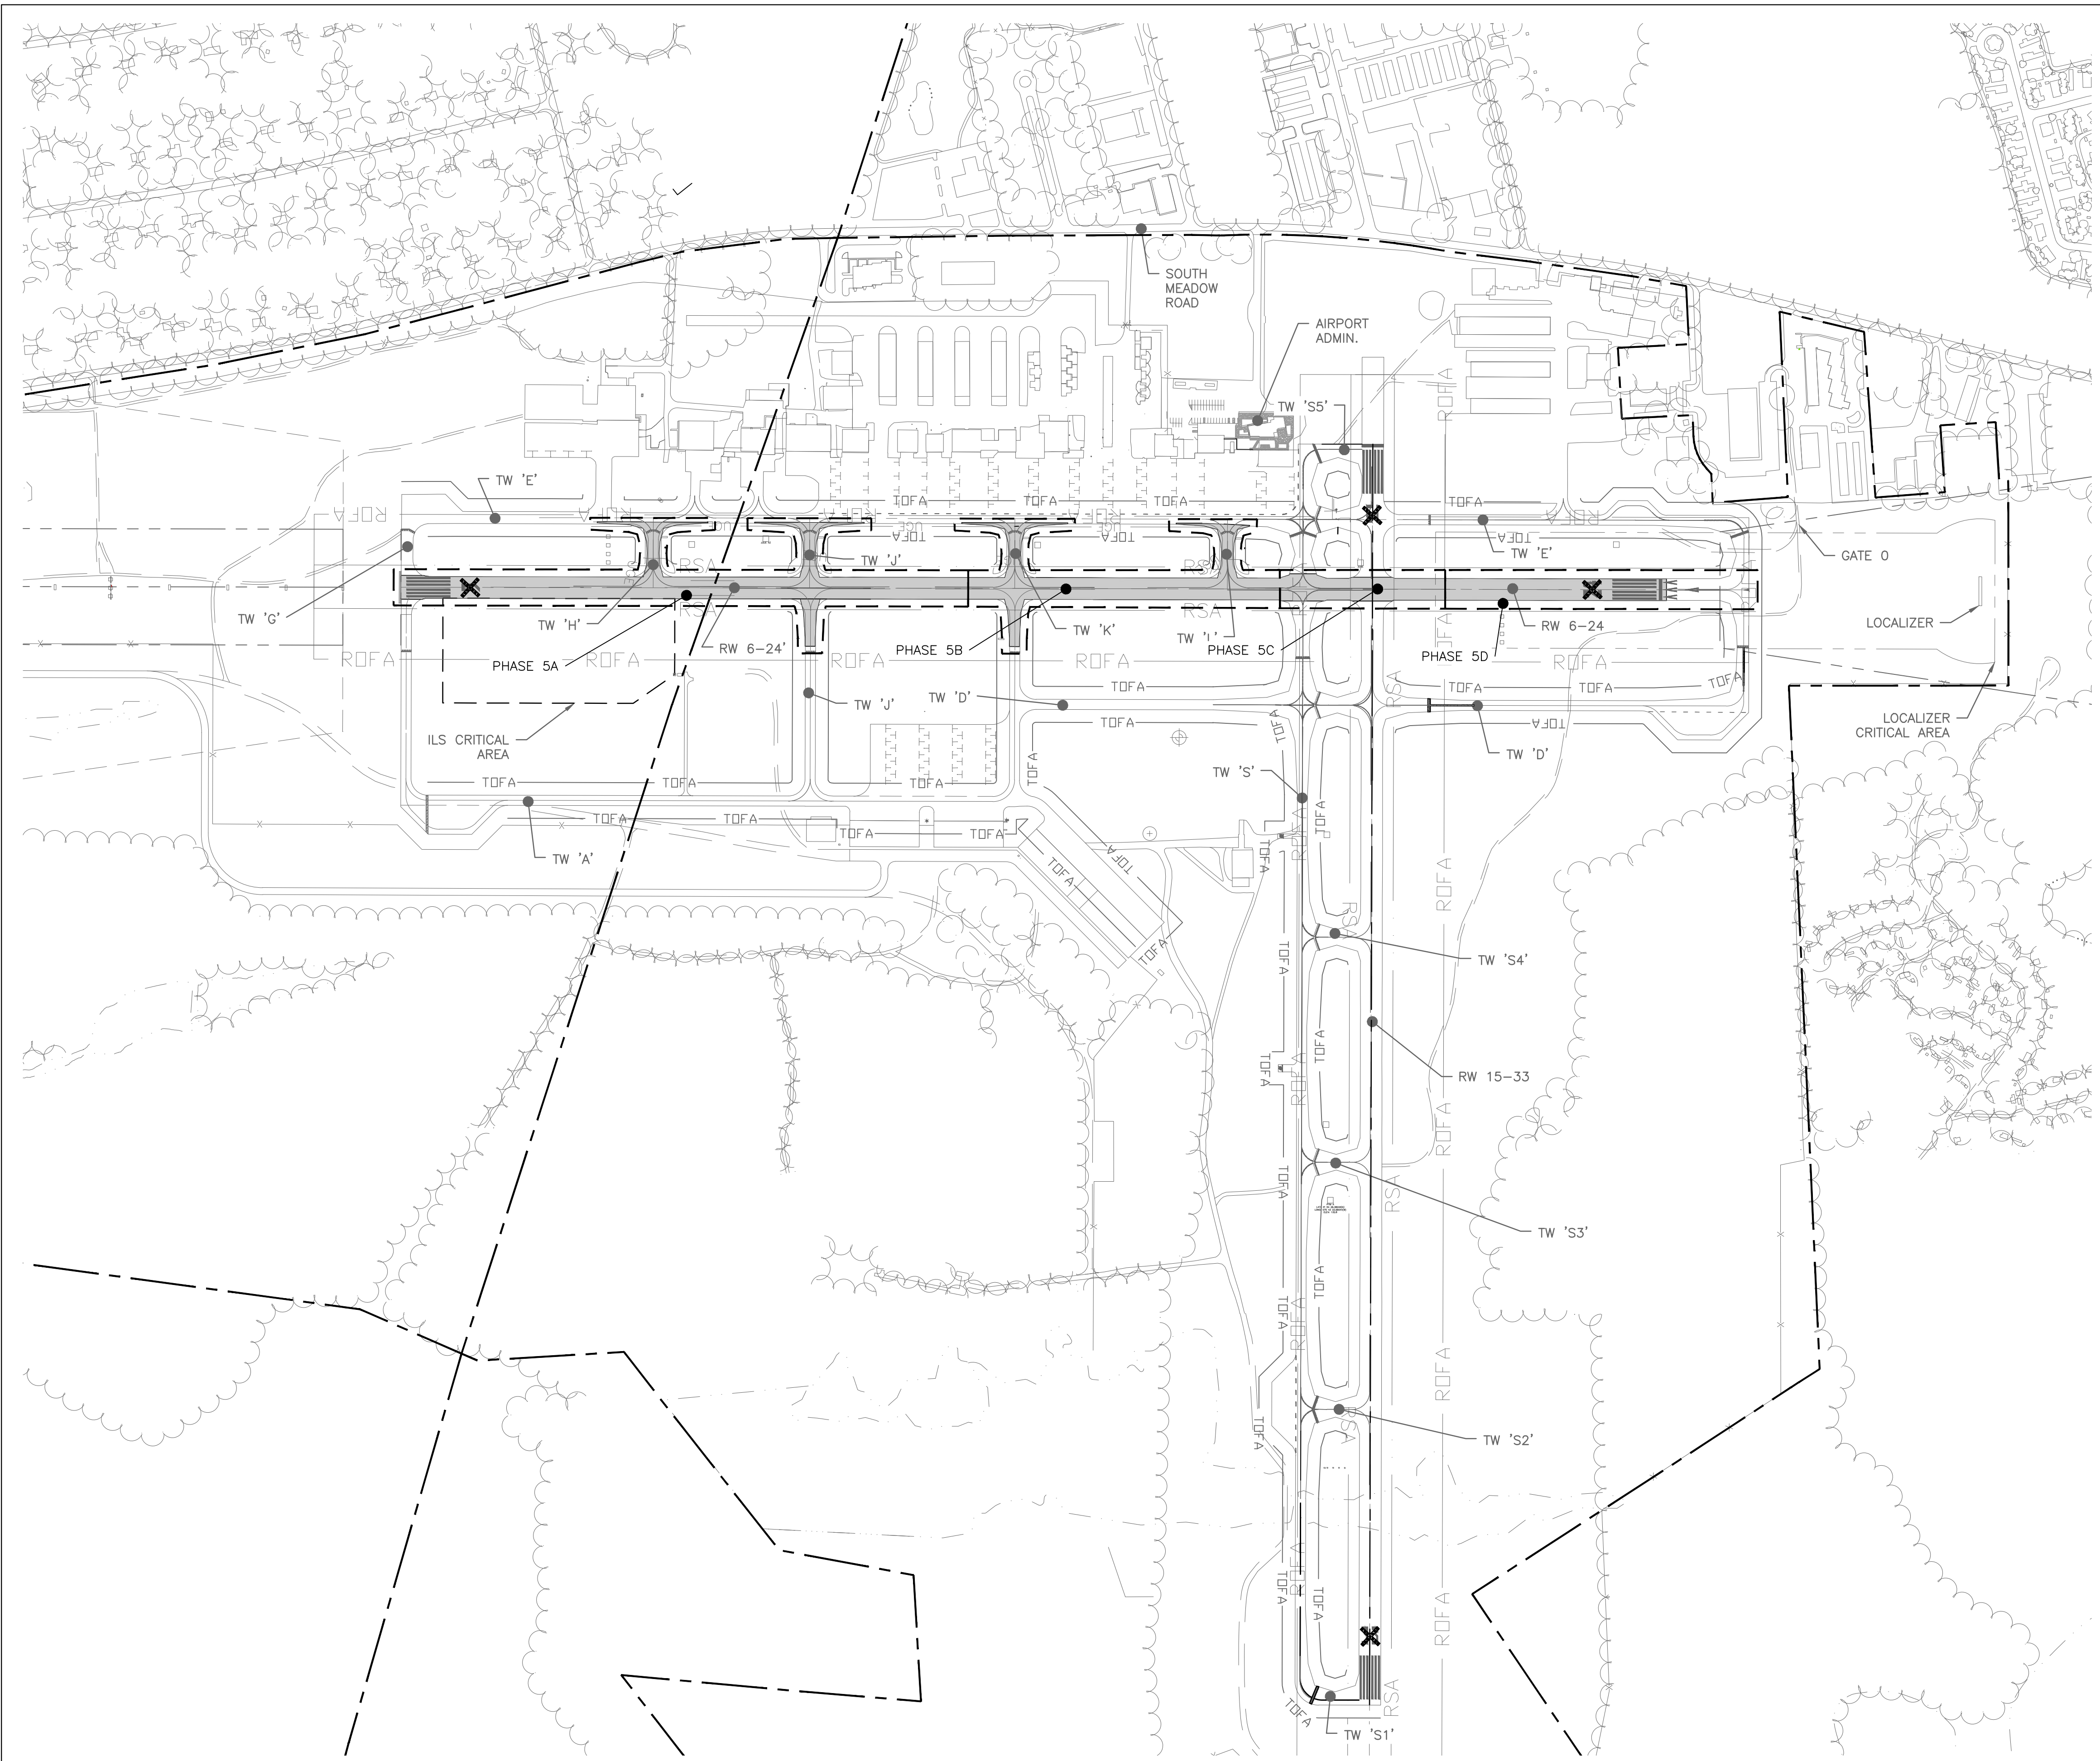

I:\3\331139 Plymouth Runway 6 24\Drawings\PM 6-24 Recon_CSP.dwg 4/17/2026 2:04 PM

CLIENT NAME:
PLYMOUTH AIRPORT COMMISSION
246 SOUTH MEADOW ROAD
PLYMOUTH, MASS. 02360

PROJECT NAME:
RECONSTRUCT, MARK RUNWAY 6-24 (APPROX 4,350 LF X 75 LF)

AIP NO.
3-25-0042-XXX-2025

SHEET TITLE
CONSTRUCTION SAFETY & PHASING PLAN PHASE 5

D&K PROJECT #	PROJ. ENG.
331139	MCG
DRAWN BY	CHECKED BY
DSP	JAA

DATE
MARCH 2026

SHEET NUMBER
S2.5